



HEAT PUMP WITH SECOND STAGE CHILLER

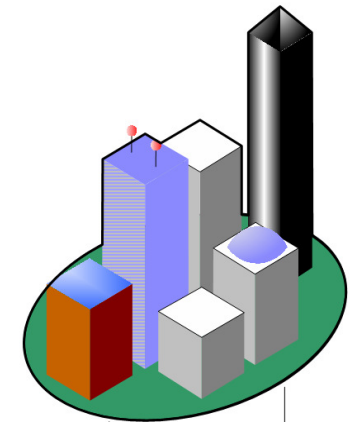

District

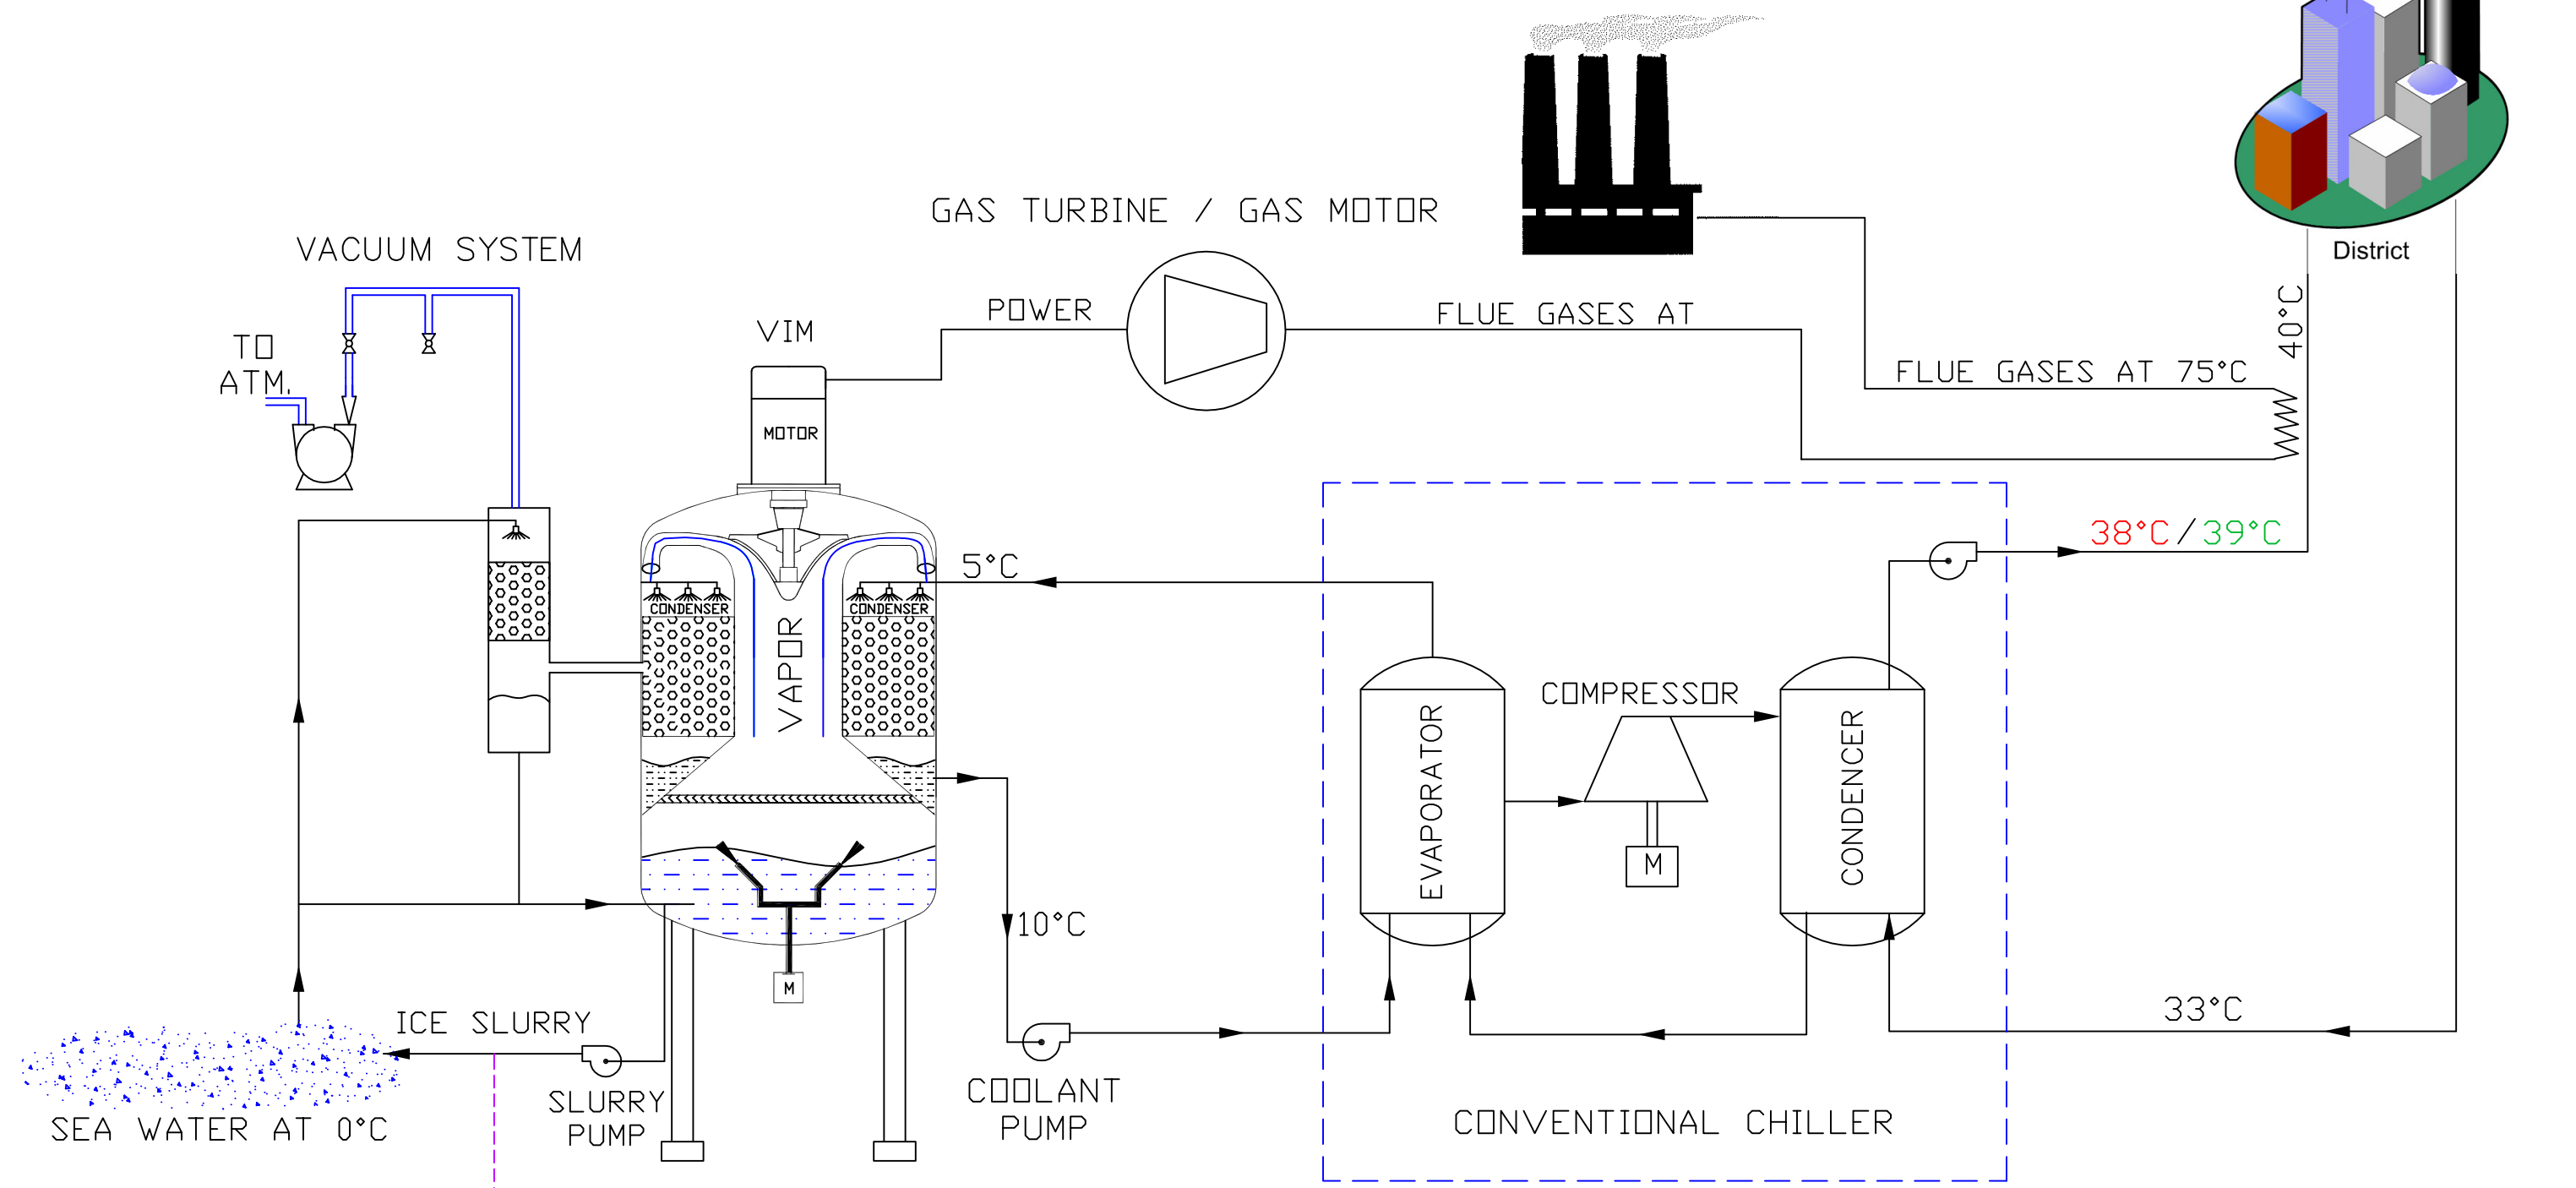

OPTIONAL FOR T.E.S COOLING SYSTEM

RED - WHEN USING GAS TURBINE
GREEN - WHEN USING GAS MOTOR

| | | | |
|---|--------------------|--------------|----------|
| CONFIDENTIAL THIS DRAWING & INFORMATION IS THE PROPERTY OF I.D.E AND UNAUTHORIZED USE OR REPRODUCTION IS PROHIBITED | | NAME | DATE |
| TITLE HEAT PUMP WITH SECOND STAGE CHILLER FLOW DIAGRAM | DRAWN | N. MALKIN | 27.07.06 |
| | DESIGN | R. SILUK | 27.07.06 |
| | CHECKED | T. EFRAT | 27.07.06 |
| | APPROV. | | |
| | Q/A | | |
| APP.REV. | | | |
| DWG. No. | MKH-20198 | Sheet 1 of 1 | |
| I.D.E TECHNOLOGIES Ltd. P.O.B 5016 KADIMA 60920, Israel TEL.(972)09-8929777, FAX.(972)09-8929759 | CODE MKH20198-1 | | REV. No. |